



MECHANICAL ALUMINUM STRUCTURAL RAILING

MECHANICAL ATTACHMENTS U.N.O., N.T.S.

DRAWING VALID ONLY WITH ORIGINAL SIGNATURE AND RAISED SEAL OR DIGITAL SEAL. VALID FOR 500FT OF RAILING AT (1) LOCATION PER SEALED DRAWING (U.N.O.).

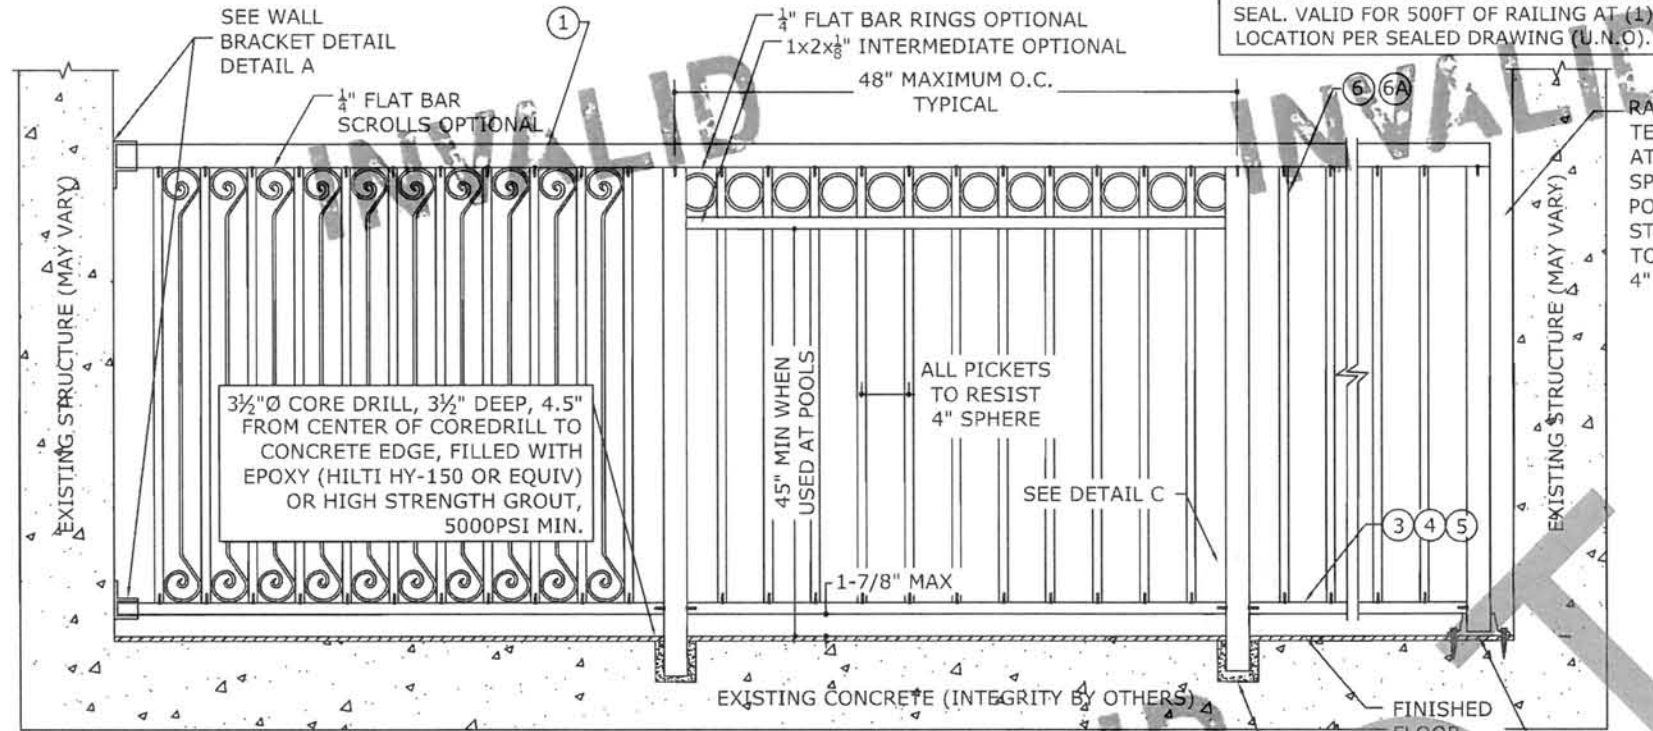

RAILING MAY TERMINATE AT POST, SPACE FROM POST TO STRUCTURE TO RESIST A 4" SPHERE

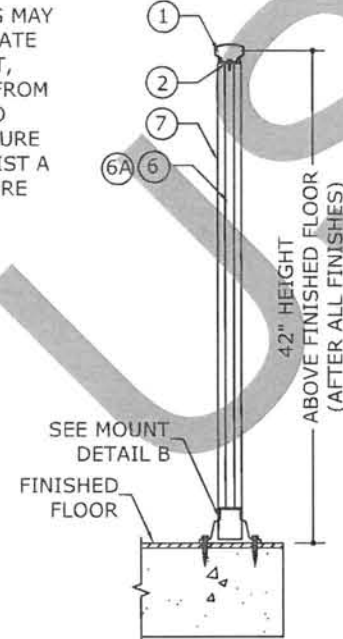


GENERAL NOTES

- THIS SYSTEM HAS BEEN DESIGNED AND SHALL BE FABRICATED IN ACCORDANCE WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE SIXTH EDITION (2017).
- THIS RAILING IS DESIGNED TO MEET SECTIONS OF THE CODE GOVERNING ELEVATED BALCONIES AND STRUCTURAL RAILINGS (200LB POINT LOAD, 50PLF TOPCAP LOAD, 50LB POINT LOAD UPON 15F OF INFILL (NONHVHZ CRITERIA FBC 1607.8.1), RAILING DESIGNED FOR WIND LOADING PER CHAP 16 HVHZ & THE PROVISIONS OF ASCE 7-10, Vult = 175 MPH, Vasd = 135.5 MPH, EXPOSURE 'D', AS AN 80% OPEN SIGN USING "ASD" METHODOLOGY. SEISMIC DOES NOT GOVERN.
- INSTALLATION HEIGHT <= 60 FEET GROUND TO TOP OF RAIL.
- ALL FLOOR FINISHES SHALL BE BY OTHERS AND SHALL NOT EXCEED 1/2" MAXIMUM, OTHERWISE THEY SHALL BE SEPARATELY CERTIFIED TO TRANSFER ALL LOADING TO THE PROJECT SUPERSTRUCTURE. DIMENSIONS ARE POST-FLOOR FINISHES.
- ALL FASTENERS TO BE #12 X 3/4" OR GREATER 2024-T4, 18-8 SERIES 300 NON-MAGNETIC STAINLESS STEEL, OR CADMIUM PLATED OR OTHERWISE CORROSION RESISTANT MATERIAL AND SHALL COMPLY WITH THE ALUMINUM ASSOCIATION, INC., & APPLICABLE FEDERAL, STATE, AND LOCAL CODES.
- ALL EXTRUDED MEMBERS SHALL BE ALUMINUM ALLOY TYPE 6061-T6 OR 6005-T5.
- ALL CONCRETE SHALL BE UNCRACKED ONLY WITH A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI U.N.O. AND SHALL BE MINIMUM 1.5X THICKER THAN ANY MEMBER EMBEDMENT. ALL EPOXY AND GROUT SHALL MEET 5000 PSI MIN. COMPRESSIVE STRENGTH AND SHALL BE IRON-FREE, NONSHRINK AND NONREACTIVE.
- FOR ALUMINUM ATTACHMENTS ALL ANCHORS SHALL BE SPACED WITH 2xDIAMETER END DISTANCE AND 2.5xDIAMETER MIN SPACING TO ADJACENT ANCHORS, UNLESS NOTED OTHERWISE. FOR STEEL ATTACHMENTS ALL ANCHORS SHALL BE SPACED WITH 3xDIAMETER MIN. SPACING TO ADJACENT ANCHORS AND 3xDIAMETER MIN END DISTANCE.
- THE CONTRACTOR IS RESPONSIBLE TO INSULATE ALL MEMBERS FROM DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS.
- ELECTRICAL GROUND, WHEN REQUIRED, TO BE DESIGNED & INSTALLED BY OTHERS.
- ENGINEER SEAL AFFIXED HERETO VALIDATES STRUCTURAL DESIGN AS SHOWN ONLY. USE OF THIS SPECIFICATION BY CONTRACTOR, ET AL. INDEMNIFIES & SAVES HARMLESS THIS ENGINEER FOR ALL COST & DAMAGES INCLUDING LEGAL FEES & APPELLATE FEES RESULTING FROM MATERIAL FABRICATION, SYSTEM ERECTION, CONSTRUCTION PRACTICES BEYOND THAT WHICH IS CALLED FOR BY LOCAL, STATE, & FEDERAL CODES & FROM DEVIATIONS OF THIS PLAN.
- THIS DOCUMENT IS GENERIC AND DOES NOT PERTAIN TO ANY SPECIFIC PROJECT SITE. ENGINEERING EXPRESS SHALL NOT BE HELD RESPONSIBLE OR LIABLE IN ANY WAY FOR ERRONEOUS OR INACCURATE DATA OR MEASUREMENTS. DIMENSIONS ARE SHOWN TO ILLUSTRATE DESIGN FORCES AND OTHER DESIGN CRITERIA. THEY MAY VARY SLIGHTLY, BUT MUST REMAIN WITHIN THE LIMITATIONS SPECIFIED HEREIN. WORK SHALL BE FIELD VERIFIED BY OTHERS PRIOR TO CONSTRUCTION. ENGINEERING EXPRESS SHALL BE NOTIFIED AND GIVEN AN OPPORTUNITY TO REEVALUATE OUR WORK UPON DISCOVERY OF ANY INACCURATE INFORMATION PRIOR TO MODIFICATION OF EXISTING FIELD CONDITIONS AND FABRICATION AND INSTALLATION OF MATERIALS. ALTERATIONS OR ADDITIONS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.
- EXCEPT AS EXPRESSLY PROVIDED HEREIN, NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED.


RAILING ELEVATION (MULTIPLE OPTIONS SHOWN)

DETAIL 'A' WALL CONNECTIONS

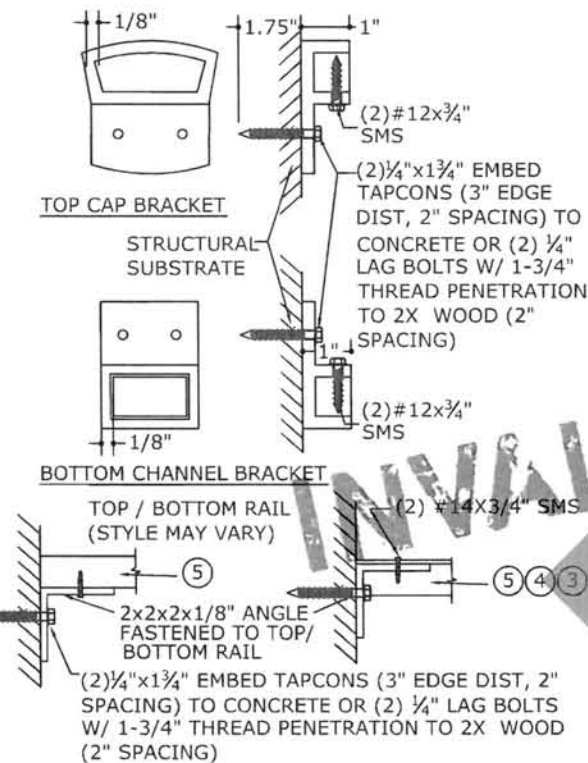


ALTERNATE RAIL CONNECTION DETAIL

DETAIL 'B' ALUMINUM CASTING

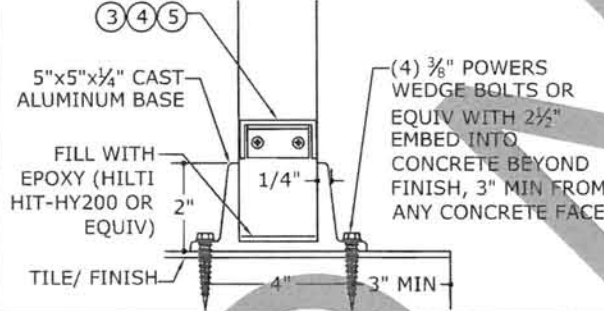


DETAIL 'C' BOTTOM RAIL CONNECTION

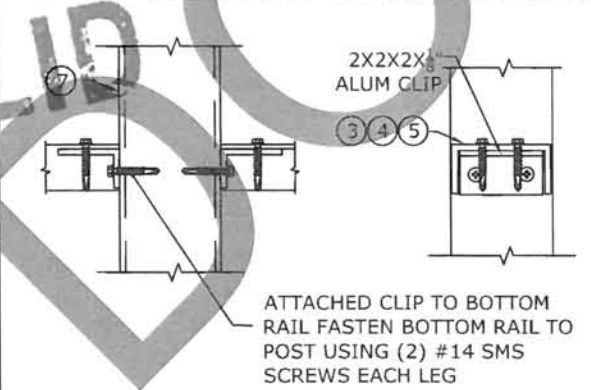


IT IS NOT PERMITTED WELD CLIP TO POST

DETAIL 'D' TOP CAP CONNECTION

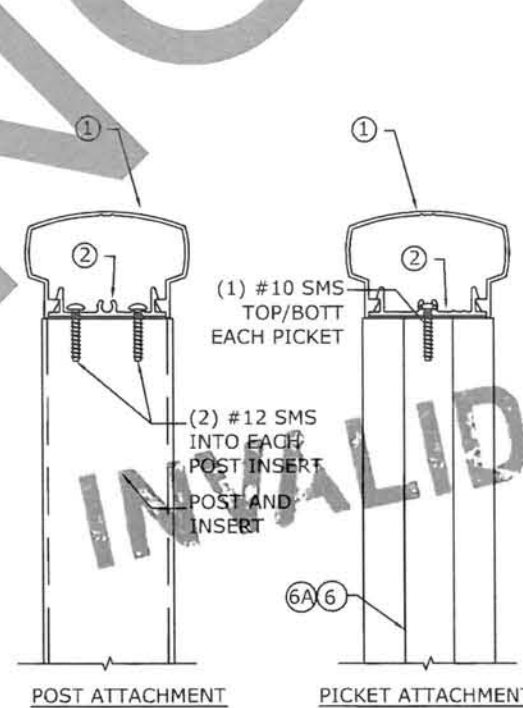

EXTRUSIONS (INCHES)

6061-T6, OR 6005-T5
EXTRUSION TOLERANCES TO BE PER INDUSTRY STANDARDS

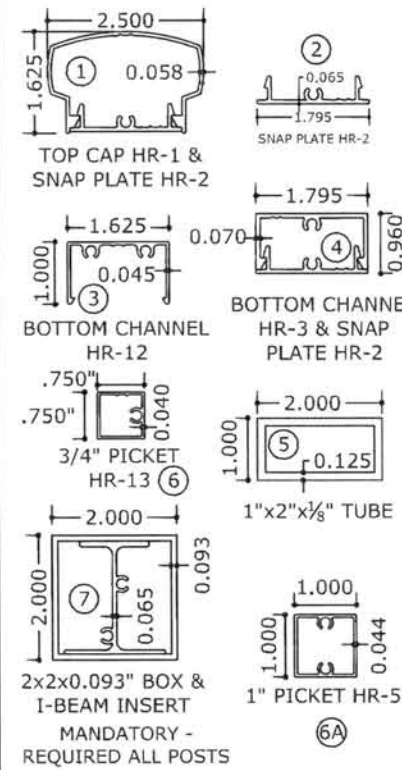

PE SEAL REQUIRED 2/23/2019

VALID FOR 1 PERMIT ONLY U.N.O.
NOTICE: IF THIS SHEET DOES NOT CONTAIN AN ORIGINAL SIGNATURE & ENGINEER SEAL: IF THERE IS A DIGITAL SIGNATURE ON SHEET 1, THIS SHEET IS PART OF A DIGITALLY SIGNED FILE, SHALL REMAIN IN DIGITAL FORMAT, & PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED. IF THERE IS NO DIGITAL SIGNATURE ON SHEET 1 OR THIS SHEET DOES NOT CONTAIN AN ENGINEER'S ORIGINAL SIGNATURE & SEAL, THIS SHEET IS A COPY/DRAFT.

ENGINEERING EXPRESS
CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
P: (954) 354-0660 F: (954) 354-0443
E: HELLO@ENGINEERINGEXPRESS.COM

MECHANICAL ALUMINUM STRUCTURAL RAILING
MASTER PLAN SHEET
ASCE 7-10 'OPEN SIGN METHOD' UP TO 60FT ABOVE GRADE
FLORIDA BUILDING CODE SIXTH EDITION (2017)

DRWN	CHKD	DATE
FLB	FLB	12/05/07
TSB	FLB	03/08/12
JAC	TSB	06/10/15
LAO	FLB	01/22/18

REMARKS:
INIT ISSUE
REVISE FOR 10 FBC
REVISE FOR 14 FBC
REVISE FOR 17 FBC

THIS DOCUMENT IS THE PROPERTY OF ENGINEERING EXPRESS AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF ENGINEERING EXPRESS. ALTERATIONS, ADDITIONS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT ENGINEERING EXPRESS®
MPS 18-5649

SCALE: NTS UNLESS NOTED

ABOUT THIS DOCUMENT
ENGINEER-CERTIFIED ORIGINALS, VARIATIONS & MORE INFORMATION CAN BE FOUND BY VISITING ENGINEERINGEXPRESS.COM/STORE OR BY SCANNING OR USING THE WEB ADDRESS FOUND HERE >

THIS DOCUMENT NOT VALID WITHOUT ORIGINAL ENGINEER CERTIFICATION

SCAN HERE:
OR, GO TO
ECLAL01/185648